
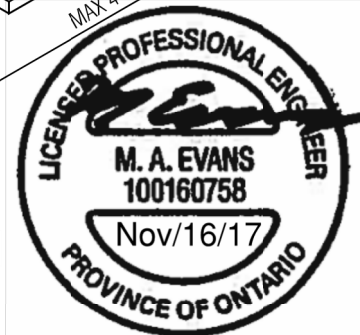


NOTES:

1. ALL WORK SHALL BE IN ACCORDANCE WITH OHS&A & CONST. REGULATIONS 213/91
2. MINIMUM GRADE OF WOOD MEMBERS SPF No 1/No 2 OR BETTER
3. THE ADEQUACY OF THE FLOOR TO BE INSPECTED BY A COMPETENT PERSON PRIOR TO SUPPORTING OF THE STAIRS
4. TEMPORARY STAIR SUPPORT IS DESIGNED FOR MAX. LIVE LOAD OF 4.8 kN/m<sup>2</sup> (100 Psi)

TABLE 3.12.1

Plank Size Positioned on Flat	Centre to Centre Spacing	Maximum Length
2x4	6"	5'-0"
2x4	12"	4'-0"
2x4	24"	3'-0"
2x6	12"	5'-0"
2x6	24"	3'-6"
Plank Size Positioned on Edge	Centre to Centre Spacing	Maximum Length
2x4	12"	5'-6"
2x4	16"	5'-0"
2x4	24"	4'-0"
2x6	12"	9'-0"
2x6	16"	8'-0"

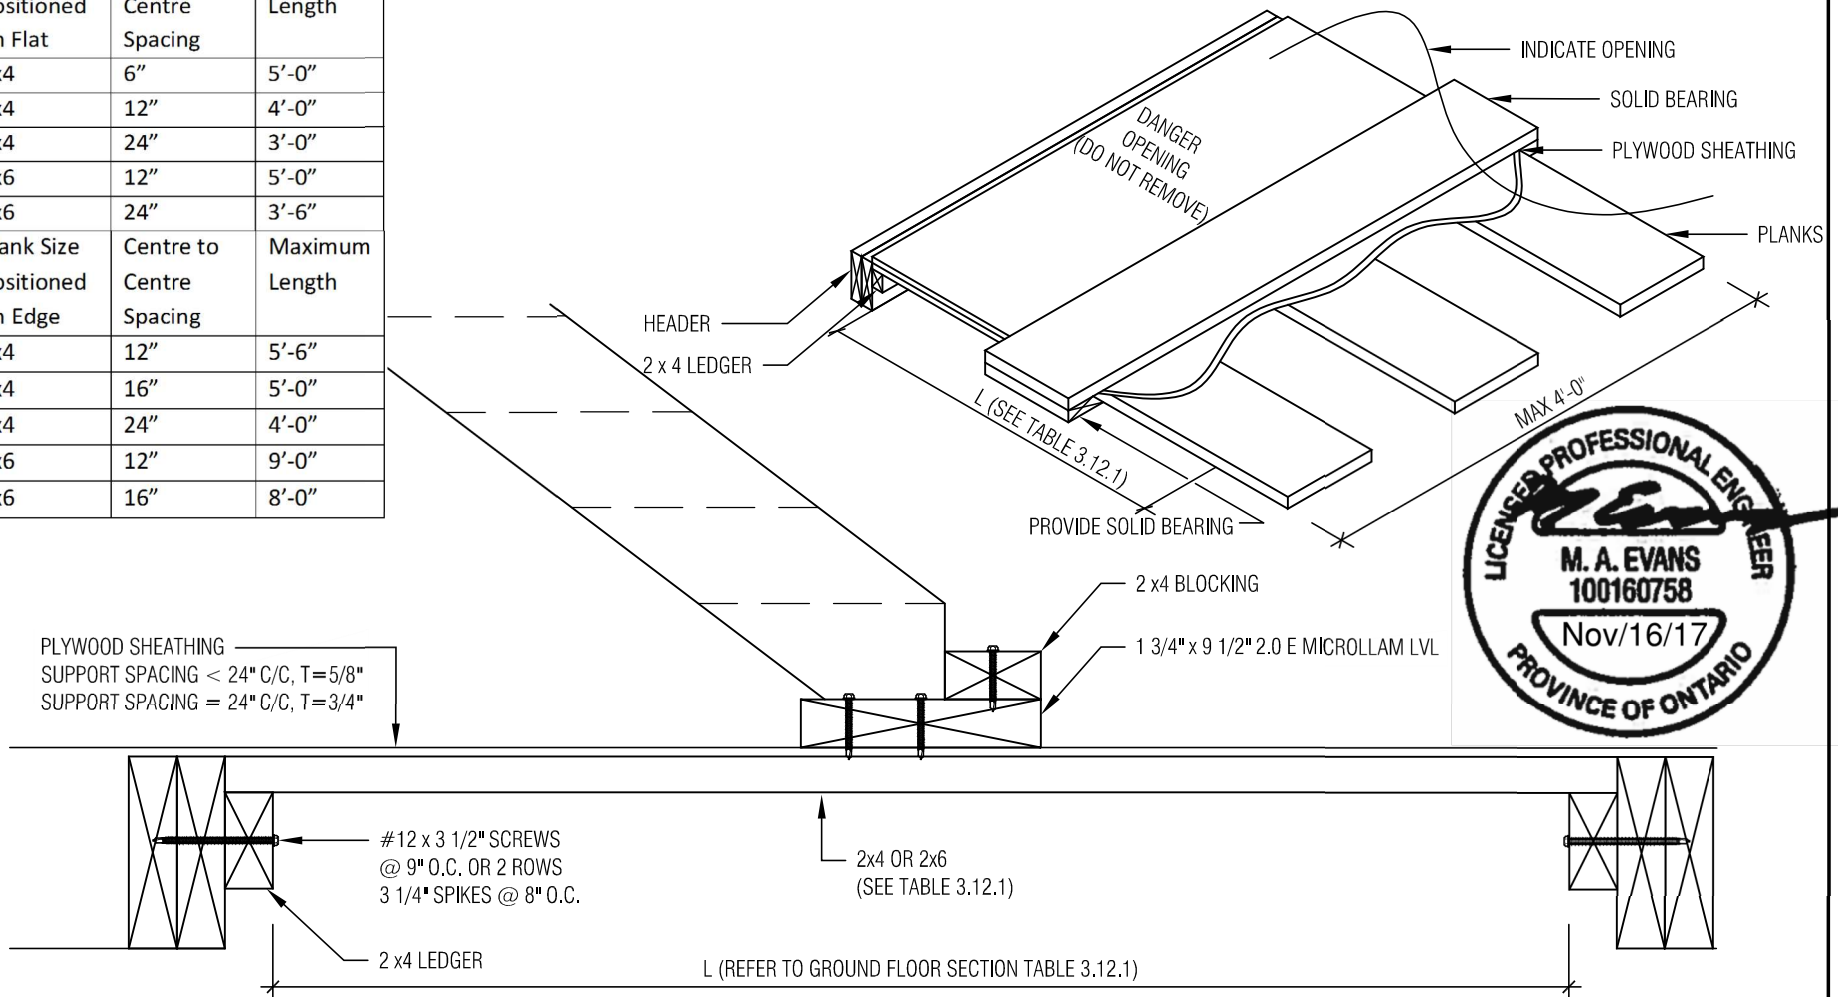

TITLE	DWG. NO.
TEMPORARY STAIR SUPPORT OVER OPENING IN FLOOR FRAMING	SK 3.1